

OFFICIAL COPY

FILED
SEP 01 2009
Clerk's Office
N.C. Utilities Commission

August 31, 2009

Renee Vance, Chief Clerk
North Carolina Utilities Commission
430 N. Salisbury Street
Dobbs Building
Raleigh, North Carolina 27603-5918

E-100 Sub 124

Re: EnergyUnited - 2009 Integrated Resource Plan and Annual Report

Dear Ms. Vance:

Please find enclosed for filing an original and thirty (30) copies of EnergyUnited's 2009 Integrated Resource Plan and Annual Report. Also included is a certification document that you have requested in the past.

If you have any questions, please do not hesitate to contact me at 704.924.2135

Sincerely,



H. Wayne Wilkins
Chief Executive Officer

cc: Giselle Rankin, NCUC

Full Distribution-AS

Integrated Resource Plan Summary

This document represents EnergyUnited EMC's Integrated Resource Plan and Annual Report filed with the North Carolina Utilities Commission (NCUC), including a forecast of loads and resources to meet their power supply needs over the next fifteen years. In addition, this report incorporates EnergyUnited's efforts towards compliance with its obligations under the Senate Bill 3 Renewable Portfolio Standards.

Under the Wholesale Power Supply Agreement (WPSA) with North Carolina Electric Membership Corporation (NCEMC), NCEMC is obligated to supply Independent Members with electric power and energy from its existing contract and generation resources. To the extent that the electric power and energy supplied under the WPSA is not sufficient to meet the electric energy requirements of its member/consumers, the Independent Members must independently arrange for purchases of electric power and energy from a third party. In December 2003, the WCE members entered into a Power Purchase Agreement with Morgan Stanley Capital Group, Inc. (Morgan Stanley) that was effective January 1, 2004.

EnergyUnited is constantly reviewing the wholesale power supply market looking for opportunities to purchase incremental power supply above the NCEMC, Southeastern Power Administration (SEPA) and Morgan Stanley purchases to meet its load requirements. As a result of an RFP process in 2005, EnergyUnited has signed long-term agreements with Southern Power Company and Southern Company Services, Inc. that were effective September 1, 2006. Through these agreements and the purchases from NCEMC, SEPA and Morgan Stanley, EnergyUnited's power supply needs will be met through the planning period.

EnergyUnited is a transmission dependent utility and relies on the transmission system of Duke Energy to transfer power purchases to their loads. EnergyUnited receives Network Integration Transmission Service under Part III of the Open Access Transmission Tariff with Duke Transmission.

As a part of EnergyUnited's plan to comply with the requirements of the REPS pursuant to Rule R8-67(b), the following action steps are currently underway:

- (i) EnergyUnited has contracted with Iredell Transmission, LLC for the purchase of the energy from a 3 MW landfill gas generator in Iredell County NC. This project began generating in 4th quarter 2008. This facility has the potential to grow to approximately 5 MW over the coming years.
- (ii) EnergyUnited has signed a twenty year Purchased Power Agreement with Sun Edison to construct a 1 MW solar array in Alexander County. This facility is proposed to be operational by the end of 2009.
- (iii) EnergyUnited has signed a contract to purchase Renewable Energy Credits from Salem Energy Systems LLC for the REC's generated from the Forsyth County Landfill for 2008 through 2010.
- (iv) EnergyUnited has made a one-time purchase of Renewable Energy Credits generated from an out of State Wind Farm that has registered with the NCUC.
- (v) EnergyUnited has submitted two Energy Efficiency Programs to the NCUC for approval. One program targets Commercial and Industrial lighting upgrades and the

other targets high efficiency heat pumps. . In 2007 and 2008 EnergyUnited gave away Compact Fluorescent Lights to its members that attended the Annual Meeting. EnergyUnited continues the process of educating its membership on the value of energy efficiency and conservation. This education plan includes monthly articles in the EnergyUnited newsletter along with interactive tools on the EnergyUnited website.

- (vi) Based on Senate Bill 3, EnergyUnited's SEPA resource may apply depending on clarification of the resource from SEPA of the REPS requirements.

The following is EnergyUnited's response to the requested data as outlined in NCUC's Rule R8-60:

Section I: EnergyUnited Integrated Resource Plan

1. Forecasts of Load, Supply-Side Resources, and Demand-Side Resources:

- Table 1.1 provides a ten-year history and a 15-year forecast of EnergyUnited's customers by each customer class, along with a ten-year history and a 15-year forecast of the energy sales (kWh) by each customer class.
- Table 1.2 and 1.3 provide a 15-year forecast of EnergyUnited's peak load requirements and resources from 2010 through 2024 for both the summer and winter periods. EnergyUnited's portfolio of resources (NCEMC WPSA, SEPA, Morgan Stanley, Southern Power Company and Southern Company Services) meet EnergyUnited's summer and winter load requirements. EnergyUnited continues to utilize its demand side resources, which are limited to residential water heater and air conditioning controls, along with commercial/industrial customer owned stand-by generation. These resources are utilized during peak hours to limit the overall demand on the system, and also provides as an additional reserve capacity resource. EnergyUnited is developing several energy efficiency programs such as High Efficiency lighting targeted at a reduction in consumption.
- Table 1.4 provides a chart of EnergyUnited's Load Duration Curve for the summer and winter peaks.
- Load forecasting methods and models:

EnergyUnited employs TSE Services to develop its annual load forecast. TSE is responsible for the coordination of the forecasting effort including consumer research, energy and demand forecasting, and weather data analysis. The load forecast is reviewed, adjusted and revised, if necessary, by EnergyUnited.

Customers, energy and demand are forecast on a monthly basis. The customer forecast and the energy sales forecast are completed for each retail class listed on the RUS Form 7. These classes include residential, seasonal, commercial, industrial, and other. The system monthly energy is the sum of the retail class energy sales adjusted for losses.

Residential and commercial customers are forecast using regression analysis. This forecast of customers, by retail class is then utilized in developing the energy forecast. For both the residential and commercial energy forecast, the forecast of customer growth of each class is multiplied by the forecast of average energy consumption per customer for that class, under the assumption of normal weather. Industrial customers are modeled on an individual basis. The demand forecast is developed similarly to the energy forecast by multiplying the number of customers and an average hourly demand per customer.

| Table 1.1: | | EnergyUnited Customer Class and Energy Sales | | | | | | | | | | | | | | | | | | | | | | | | |
|--------------------|--|----------------------------------------------|-----------|-----------|-----------|-----------|-----------|-----------|-----------|-----------|-----------|-----------|-----------|-----------|-----------|-----------|-----------|-----------|-----------|-----------|-----------|-----------|-----------|-----------|-----------|-----------|
| CUSTOMERS BY CLASS | | 15 year forecast and 10 year history | | | | | | | | | | | | | | | | | | | | | | | | |
| | | 2000 | 2001 | 2002 | 2003 | 2004 | 2005 | 2006 | 2007 | 2008 | 2009 | 2010 | 2011 | 2012 | 2013 | 2014 | 2015 | 2016 | 2017 | 2018 | 2019 | 2020 | 2021 | 2022 | 2023 | 2024 |
| RESIDENTIAL | | 93,364 | 96,139 | 97,224 | 97,255 | 100,920 | 102,956 | 105,104 | 101,673 | 102,464 | 102,464 | 102,647 | 102,939 | 103,454 | 105,748 | 108,113 | 110,552 | 113,066 | 115,658 | 118,331 | 120,998 | 123,744 | 126,573 | 129,487 | 132,488 | 135,579 |
| SEASONAL | | 1,835 | 1,815 | 1,819 | 1,650 | 1,631 | 1,638 | 1,655 | 1,618 | 1,619 | 1,616 | 1,611 | 1,601 | 1,561 | 1,519 | 1,475 | 1,431 | 1,385 | 1,337 | 1,290 | 1,241 | 1,191 | 1,139 | 1,086 | 1,031 | |
| COMMERCIAL | | 3,851 | 4,476 | 6,186 | 7,041 | 7,015 | 8,044 | 8,951 | 15,617 | 15,959 | 16,069 | 16,297 | 16,663 | 17,035 | 17,415 | 17,803 | 18,200 | 18,606 | 19,021 | 19,445 | 19,879 | 20,322 | 20,775 | 21,238 | 21,712 | |
| INDUSTRIAL | | 24 | 18 | 21 | 24 | 18 | 17 | 17 | 17 | 16 | 16 | 16 | 16 | 16 | 16 | 16 | 16 | 16 | 16 | 16 | 16 | 16 | 16 | 16 | 16 | |
| OTHER | | 125 | 204 | 223 | 233 | 258 | 263 | 267 | 274 | 334 | 339 | 345 | 351 | 357 | 363 | 369 | 375 | 381 | 387 | 393 | 399 | 405 | 411 | 417 | 423 | 429 |
| TOTAL | | 99,199 | 102,653 | 105,473 | 106,203 | 109,842 | 112,819 | 116,014 | 119,199 | 120,392 | 120,397 | 120,713 | 121,214 | 122,081 | 124,723 | 127,432 | 130,221 | 133,094 | 136,052 | 139,096 | 142,148 | 145,285 | 148,513 | 151,834 | 155,251 | 158,767 |
| MWH SOLD BY CLASS | | | | | | | | | | | | | | | | | | | | | | | | | | |
| | | 2000 | 2001 | 2002 | 2003 | 2004 | 2005 | 2006 | 2007 | 2008 | 2009 | 2010 | 2011 | 2012 | 2013 | 2014 | 2015 | 2016 | 2017 | 2018 | 2019 | 2020 | 2021 | 2022 | 2023 | 2024 |
| RESIDENTIAL | | 1,259,211 | 1,304,776 | 1,344,419 | 1,361,340 | 1,435,927 | 1,485,753 | 1,453,606 | 1,532,644 | 1,503,982 | 1,398,911 | 1,408,216 | 1,411,508 | 1,417,100 | 1,436,805 | 1,488,811 | 1,501,811 | 1,535,834 | 1,570,904 | 1,607,073 | 1,643,727 | 1,680,907 | 1,719,207 | 1,758,853 | 1,799,283 | 1,841,131 |
| SEASONAL | | 7,482 | 7,584 | 7,753 | 7,660 | 7,320 | 7,457 | 7,355 | 7,709 | 7,452 | 7,790 | 7,775 | 7,749 | 7,705 | 7,509 | 7,308 | 7,099 | 6,884 | 6,662 | 6,433 | 6,208 | 5,971 | 5,729 | 5,479 | 5,223 | 4,959 |
| COMMERCIAL | | 401,751 | 393,883 | 420,229 | 432,221 | 459,979 | 498,635 | 522,140 | 559,557 | 592,319 | 707,958 | 723,816 | 740,029 | 756,608 | 773,554 | 790,882 | 808,597 | 826,710 | 845,228 | 864,161 | 883,518 | 903,310 | 923,544 | 944,231 | 965,382 | |
| INDUSTRIAL | | 74,330 | 108,549 | 124,718 | 121,961 | 124,977 | 142,559 | 151,621 | 156,112 | 151,486 | 145,727 | 145,800 | 145,873 | 145,946 | 146,018 | 146,018 | 146,018 | 146,018 | 146,018 | 146,018 | 146,018 | 146,018 | 146,018 | 146,018 | 146,018 | |
| OTHER | | 1,248 | 2,453 | 3,245 | 3,159 | 3,527 | 3,935 | 4,026 | 2,557 | 4,448 | 5,138 | 5,226 | 5,316 | 5,406 | 5,496 | 5,586 | 5,676 | 5,766 | 5,857 | 5,947 | 6,037 | 6,127 | 6,217 | 6,307 | 6,397 | |
| TOTAL | | 1,744,000 | 1,817,245 | 1,900,364 | 1,828,341 | 2,030,730 | 2,138,339 | 2,136,748 | 2,258,579 | 2,260,067 | 2,263,439 | 2,280,743 | 2,310,363 | 2,332,673 | 2,369,292 | 2,418,513 | 2,468,111 | 2,521,122 | 2,574,576 | 2,629,542 | 2,685,417 | 2,742,243 | 2,800,825 | 2,860,598 | 2,922,213 | 2,985,511 |

Table 1.2: EnergyUnited Total Projected Summer Load and Capacity (2009 Load Forecast)

| EnergyUnited | | | | 2010 | 2011 | 2012 | 2013 | 2014 | 2015 | 2016 | 2017 | 2018 | 2019 | 2020 | 2021 | 2022 | 2023 | 2024 |
|---------------------------------------------------------------|--------------------|-------------|---------------------------|-------------|----------------------|-------------|---------|---------|---------|---------|---------|---------|---------|---------|---------|---------|---------|---------|
| Load Requirements: | | | | | | | | | | | | | | | | | | |
| PEAK BEFORE ANTICIPATED ENERGY EFFICIENCY PROGRAMS (MW) (1) | | | | 566.3 | 578.0 | 580.2 | 584.0 | 594.1 | 607.5 | 621.3 | 635.5 | 650.2 | 666.2 | 682.5 | 699.0 | 716.0 | 733.4 | 751.3 |
| Less: Impact of anticipated energy efficiency programs | | | | (0.3) | (1.4) | (4.8) | (7.5) | (10.5) | (10.6) | (12.5) | (12.6) | (12.6) | (12.7) | (12.8) | (12.9) | (13.0) | (13.1) | (13.3) |
| PEAK NET OF ANTICIPATED ENERGY EFFICIENCY PROGRAMS | | | | 566.0 | 576.6 | 575.3 | 576.5 | 583.5 | 596.9 | 608.8 | 623.0 | 637.5 | 653.5 | 669.6 | 686.1 | 703.0 | 720.3 | 738.1 |
| Purchased Resources: (2) | | | | | | | | | | | | | | | | | | |
| NCEMC Existing Resources | | | | | | | | | | | | | | | | | | |
| Catawba Nuclear Station | Duke Control Area | Nuclear | Base | 79.0 | 79.0 | 79.0 | 79.0 | 79.0 | 79.0 | 79.0 | 79.0 | 79.0 | 79.0 | 79.0 | 79.0 | 79.0 | 79.0 | 79.0 |
| AEP Purchase | Duke Control Area | Coal | Base | 26.0 | 0.0 | 0.0 | 0.0 | 0.0 | | | | | | | | | | |
| CP&L SOR A | Duke Control Area | Mix | Base | 29.0 | 0.0 | 0.0 | 0.0 | 0.0 | | | | | | | | | | |
| SCE&G Intermediate Resource | Duke Control Area | Gas | Intermediate | 32.0 | 32.0 | 32.0 | 0.0 | 0.0 | | | | | | | | | | |
| AEP Baseload Resource | Duke Control Area | Mix | Base | 19.0 | 19.0 | 19.0 | 0.0 | 0.0 | | | | | | | | | | |
| Dominion PPA | Duke Control Area | Mix | Intermediate | 19.0 | 19.0 | 19.0 | 19.0 | 19.0 | | | | | | | | | | |
| Total NCEMC Existing Resources | | | | 204.0 | 149.0 | 149.0 | 98.0 | 98.0 | 79.0 | 79.0 | 79.0 | 79.0 | 79.0 | 79.0 | 79.0 | 79.0 | 79.0 | 79.0 |
| SEPA | Southeast | | Base/Peaking | 16.0 | 16.0 | 16.0 | 16.0 | 16.0 | 16.0 | 16.0 | 16.0 | 16.0 | 16.0 | 16.0 | 16.0 | 16.0 | 16.0 | 16.0 |
| Morgan Stanley Purchases (3) | | | | | | | | | | | | | | | | | | |
| Total Morgan Stanley Purchases | Various | Mix | Base/Intermediate/Peaking | 265.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | | | | | | | | |
| Southern Power/Southern Company Purchases (4) | | | | | | | | | | | | | | | | | | |
| Total Southern Purchases | Various | Mix | Base/Intermediate/Peaking | 81.0 | 411.6 | 410.3 | 462.5 | 469.5 | 501.9 | 513.8 | 528.0 | 542.5 | 558.5 | 574.6 | 591.1 | 608.0 | 625.3 | 643.1 |
| TOTAL RESOURCES (MW) | | | | 566.0 | 576.6 | 575.3 | 576.5 | 583.5 | 596.9 | 608.8 | 623.0 | 637.5 | 653.5 | 669.6 | 686.1 | 703.0 | 720.3 | 738.1 |
| RESERVE CAPACITY (MW) (4) | | | | 85.0 | 86.7 | 87.0 | 87.6 | 89.1 | 91.1 | 93.2 | 95.3 | 97.5 | 99.9 | 102.4 | 104.9 | 107.4 | 110.0 | 112.7 |
| REPS Resources | | | | | | | | | | | | | | | | | | |
| ANNUAL ENERGY BEFORE ENERGY EFFICIENCY PROGRAMS(GWH) (5) | | | | 2,506.1 | 2,527.5 | 2,551.9 | 2,591.9 | 2,645.7 | 2,701.0 | 2,757.9 | 2,816.3 | 2,876.3 | 2,937.4 | 2,999.5 | 3,063.3 | 3,128.9 | 3,196.2 | 3,265.4 |
| Less: Impact of anticipated energy efficiency programs | | | | (0.83) | (2.01) | (3.42) | (5.12) | (7.05) | (7.05) | (7.05) | (7.05) | (7.05) | (7.05) | (7.05) | (7.05) | (7.05) | (7.05) | (7.05) |
| NET ANNUAL ENERGY | | | | 2,505.2 | 2,525.5 | 2,548.5 | 2,586.8 | 2,638.7 | 2,694.0 | 2,750.8 | 2,809.2 | 2,869.3 | 2,930.4 | 2,992.5 | 3,056.3 | 3,121.8 | 3,189.1 | 3,258.3 |
| Capacity from renewable resources(MW): | | | | | | | | | | | | | | | | | | |
| Iredell Transmission, LLC | Iredell County, NC | Methane Gas | Base | 3.0 | 3.0 | 3.0 | 3.0 | 3.0 | 3.0 | 3.0 | 3.0 | 3.0 | 3.0 | 3.0 | 3.0 | 3.0 | 3.0 | 3.0 |
| Anticipated Solar Resources | TBD | Solar | N/A | 0.5 | 1.0 | 1.0 | 1.0 | 1.0 | 2.0 | 2.0 | 2.0 | 2.0 | 3.0 | 3.0 | 3.0 | 3.0 | 3.0 | 3.0 |
| SEPA | SouthEast | | Intermediate/Peaking | 16.0 | 16.0 | 16.0 | 16.0 | 16.0 | 16.0 | 16.0 | 16.0 | 16.0 | 16.0 | 16.0 | 16.0 | 16.0 | 16.0 | 16.0 |
| Other Anticipated Renewable Resources (TBD) | | | | TBD | TBD | | | | | | | | | | | | | |
| Total Anticipated Renewable Capacity | | | | 19.5 | 20.0 | 20.0 | 20.0 | 20.0 | 21.0 | 21.0 | 21.0 | 21.0 | 22.0 | 22.0 | 22.0 | 22.0 | 22.0 | 22.0 |
| Energy from renewable resources (GWH): | | | | | | | | | | | | | | | | | | |
| REC's Carried Forward | | | | | | | | | | | | | | | | | | |
| Iredell Transmission LLC | 32 | | | 25.0 | 25.0 | 25.0 | 25.0 | 25.0 | 25.0 | 25.0 | 25.0 | 25.0 | 25.0 | 25.0 | 25.0 | 25.0 | 25.0 | 25.0 |
| Anticipated Solar Resources | | | | 0.8 | 1.8 | 1.8 | 1.8 | 1.8 | 2.6 | 2.6 | 2.6 | 2.6 | 3.9 | 3.9 | 3.9 | 3.9 | 3.9 | 3.9 |
| SEPA | 21 | | | 21.0 | 21.0 | 21.0 | 21.0 | 21.0 | 21.0 | 21.0 | 21.0 | 21.0 | 21.0 | 21.0 | 21.0 | 21.0 | 21.0 | 21.0 |
| Nextera Wind REC's(Out of State) | 150 | | | | | | | | | | | | | | | | | |
| Salem Energy Systems LLC REC's | 60 | | | 30.0 | | | | | | | | | | | | | | |
| Other Renewable Resources/REC's needed | | | | | | | | | | | 53.6 | 239.0 | 243.8 | 250.0 | 256.4 | 263.0 | 269.7 | 276.6 |
| Demand Side Management (6) | | | | | | | | | | | | | | | | | | |
| | | | | # Customers | Demand Reduction(MW) | Days in DSM | | | | | | | | | | | | |
| DEMAND SIDE MANAGEMENT PROGRAMS:(activated during peak hours) | | | | | | | | | | | | | | | | | | |
| Residential Water Heaters | 23,659 | 7.56 | 98 hours | 7.6 | 7.6 | 7.6 | 7.6 | 7.6 | 7.6 | 7.6 | 7.6 | 7.6 | 7.6 | 7.6 | 7.6 | 7.6 | 7.6 | 7.6 |
| Coincident Peak Commercial/Industrial Consumers | 30 | 8.83 | 98 hours | 8.8 | 8.8 | 8.8 | 8.8 | 8.8 | 8.8 | 8.8 | 8.8 | 8.8 | 8.8 | 8.8 | 8.8 | 8.8 | 8.8 | 8.8 |
| Residential Air Conditioners | 26,470 | 8.65 | 98 hours | 8.7 | 8.7 | 8.7 | 8.7 | 8.7 | 8.7 | 8.7 | 8.7 | 8.7 | 8.7 | 8.7 | 8.7 | 8.7 | 8.7 | 8.7 |
| | | | | 25.0 | 25.0 | 25.0 | 25.0 | 25.0 | 25.0 | 25.0 | 25.0 | 25.0 | 25.0 | 25.0 | 25.0 | 25.0 | 25.0 | 25.0 |
| 2008 Peak- June 9th, 2008 HE 6:00pm --558 MW | | | | | | | | | | | | | | | | | | |
| 2009 Peak- TBD | | | | | | | | | | | | | | | | | | |

1. Net Peak is EnergyUnited's peak net of load management measured at generation.
2. All purchases are 100% firm with reserves provided by the supplying entity.
3. The term of the initial purchase with Morgan Stanley is 7 years beginning in 2004. All current and future resources provided by Morgan Stanley are firm; the Morgan Stanley purchase is a network resource recognized by Duke Transmission. Resources provided by Morgan to serve load in the Duke control area will come from resources in the Duke control area or through imports made with firm transmission at interties with Southern, AEP, and Yadkin. These firm transmission purchases have been designated in the application with the transmission provider.
4. The initial term of the purchase with Southern Power/Southern Company is September 1, 2006 thru December 31, 2025. All current and future resources provided by Southern are firm; the Southern purchase is a network resource recognized by Duke Transmission. Resources provided by Southern will come from resources in the Duke control area or through imports made with firm transmission at the Duke/Southern intertie. These firm transmission purchases have been designated in the application with the transmission provider or will be designated prior to the start of the start of applicable resource. Under this contract, Southern is obligated to provide all necessary reserve capacity up to 15% of EnergyUnited Peak Load
5. Energy values are measured at generation.
6. Demand Side Management allows us to reduce 21MW during peak periods at our option using load management devices and backup generation.

Table 1.3: EnergyUnited Total Projected Winter Load and Capacity (2009 Load Forecast)


| EnergyUnited | | | | 2010 | 2011 | 2012 | 2013 | 2014 | 2015 | 2016 | 2017 | 2018 | 2019 | 2020 | 2021 | 2022 | 2023 | 2024 |
|--------------------------------------------------------------|-----------------------|-------------|---------------------------|-------------|------------------|---------|-------------|---------|---------|---------|---------|---------|---------|---------|---------|---------|---------|---------|
| Load Requirements: | | | | | | | | | | | | | | | | | | |
| PEAK BEFORE ENERGY EFFICIENCY PROGRAMS (MW) (1) (6) | | | | 577.7 | 579.4 | 582.0 | 586.8 | 599.7 | 613.0 | 626.7 | 640.8 | 655.3 | 670.2 | 685.2 | 700.5 | 716.4 | 732.7 | 749.4 |
| Less: Impact of anticipated energy efficiency programs | | | | (0.3) | (1.4) | (4.9) | (7.5) | (10.5) | (10.6) | (12.5) | (12.6) | (12.7) | (12.8) | (12.9) | (12.9) | (13.0) | (13.1) | (13.2) |
| PEAK NET OF ANTICIPATED ENERGY EFFICIENCY PROGRAMS | | | | 577.4 | 578.0 | 577.1 | 579.3 | 589.2 | 602.4 | 614.2 | 628.3 | 642.6 | 657.5 | 672.3 | 687.6 | 703.4 | 719.6 | 736.2 |
| Purchased Resources: (2) | | | | | | | | | | | | | | | | | | |
| NCEMC Existing Resources | | | | | | | | | | | | | | | | | | |
| Catawba Nuclear Station | Duke Control Area | Nuclear | Base | 79.0 | 79.0 | 79.0 | 79.0 | 79.0 | 79.0 | 79.0 | 79.0 | 79.0 | 79.0 | 79.0 | 79.0 | 79.0 | 79.0 | 79.0 |
| AEP Purchase | Duke Control Area | Coal | Base | 26.0 | - | - | - | - | - | - | - | - | - | - | - | - | - | - |
| CP&L SOR A | Duke Control Area | Mix | Base | 29.0 | - | - | - | - | - | - | - | - | - | - | - | - | - | - |
| SCE&G Intermediate Resource | Duke Control Area | Gas | Intermediate | 32.0 | 32.0 | 32.0 | - | - | - | - | - | - | - | - | - | - | - | - |
| AEP Baseload Resource | Duke Control Area | Mix | Base | 19.0 | 19.0 | 19.0 | - | - | - | - | - | - | - | - | - | - | - | - |
| Dominion PPA | Duke Control Area | Mix | Intermediate | 19.0 | 19.0 | 19.0 | 19.0 | 19.0 | - | - | - | - | - | - | - | - | - | - |
| Total NCEMC Existing Resources | | | | 204.0 | 149.0 | 149.0 | 98.0 | 98.0 | 79.0 | 79.0 | 79.0 | 79.0 | 79.0 | 79.0 | 79.0 | 79.0 | 79.0 | 79.0 |
| SEPA | Southeast | | Base/Peaking | 16.0 | 16.0 | 16.0 | 16.0 | 16.0 | 16.0 | 16.0 | 16.0 | 16.0 | 16.0 | 16.0 | 16.0 | 16.0 | 16.0 | 16.0 |
| Morgan Stanley Purchases (3) | | | | | | | | | | | | | | | | | | |
| Total Morgan Stanley Purchases | Various | Mix | Base/Intermediate/Peaking | 265.0 | - | - | - | - | - | - | - | - | - | - | - | - | - | - |
| Southern Power/Southern Company Purchases (4) | | | | | | | | | | | | | | | | | | |
| Total Southern Purchases | Various | Mix | Base/Intermediate/Peaking | 92.4 | 413.0 | 412.1 | 465.3 | 475.2 | 507.4 | 519.2 | 533.3 | 547.8 | 562.5 | 577.3 | 592.6 | 608.4 | 624.6 | 641.2 |
| TOTAL RESOURCES (MW) | | | | 577.4 | 578.0 | 577.1 | 579.3 | 589.2 | 602.4 | 614.2 | 628.3 | 642.6 | 657.5 | 672.3 | 687.6 | 703.4 | 719.6 | 736.2 |
| RESERVE CAPACITY (MW) (4) | | | | 86.7 | 86.9 | 87.3 | 88.0 | 90.0 | 92.0 | 94.0 | 96.1 | 98.3 | 100.5 | 102.8 | 105.1 | 107.5 | 109.9 | 112.4 |
| REPS Resources | | | | | | | | | | | | | | | | | | |
| ANNUAL ENERGY BEFORE ENERGY EFFICIENCY PROGRAMS(GWH) (5) | | | | 2,506.1 | 2,527.5 | 2,551.9 | 2,591.9 | 2,645.7 | 2,701.0 | 2,757.9 | 2,816.3 | 2,876.3 | 2,937.4 | 2,999.5 | 3,063.3 | 3,128.9 | 3,196.2 | 3,265.4 |
| Less: Impact of anticipated energy efficiency programs | | | | (0.8) | (2.0) | (45.9) | (70.7) | (99.4) | (99.8) | (116.6) | (117.3) | (118.1) | (118.9) | (119.7) | (120.5) | (121.3) | (122.2) | (123.1) |
| NET ANNUAL ENERGY | | | | 2,505.2 | 2,525.5 | 2,506.0 | 2,521.2 | 2,546.3 | 2,601.2 | 2,641.2 | 2,698.9 | 2,758.2 | 2,818.5 | 2,879.8 | 2,942.8 | 3,007.5 | 3,074.0 | 3,142.3 |
| Capacity from renewable resources(MW): | | | | | | | | | | | | | | | | | | |
| Iredell Transmission, LLC | Iredell County, NC | Methane Gas | Base | 3.0 | 3.0 | 3.0 | 3.0 | 3.0 | 3.0 | 3.0 | 3.0 | 3.0 | 3.0 | 3.0 | 3.0 | 3.0 | 3.0 | 3.0 |
| Anticipated Solar Resources | TBD | Solar | N/A | - | 0.3 | 0.3 | 1.0 | 1.0 | 1.0 | 1.0 | 2.0 | 2.0 | 3.0 | 3.0 | 3.0 | 3.0 | 3.0 | 3.0 |
| SEPA | SouthEast | | Intermediate/Peaking | 16.0 | 16.0 | 16.0 | 16.0 | 16.0 | 16.0 | 16.0 | 16.0 | 16.0 | 16.0 | 16.0 | 16.0 | 16.0 | 16.0 | 16.0 |
| Other Anticipated Renewable Resources (TBD) | TBD | TBD | TBD | - | - | 4.5 | 4.7 | 4.9 | 5.0 | 13.4 | 13.7 | 14.1 | 31.9 | 33.0 | 34.1 | 35.2 | 36.3 | 38.0 |
| Total Anticipated Renewable Capacity | | | | 19.0 | 19.3 | 23.8 | 24.7 | 24.9 | 25.0 | 33.4 | 34.7 | 35.1 | 53.9 | 56.0 | 56.1 | 57.2 | 58.3 | 60.0 |
| Energy from renewable resources (GWH): | | | | | | | | | | | | | | | | | | |
| Iredell Transmission LLC | REC's Carried Forward | | | 25.0 | 25.0 | 25.0 | 25.0 | 25.0 | 25.0 | 25.0 | 25.0 | 25.0 | 25.0 | 25.0 | 25.0 | 25.0 | 25.0 | 25.0 |
| Anticipated Solar Resources | | | | 0.8 | 1.8 | 1.8 | 1.8 | 1.8 | 2.6 | 2.6 | 2.6 | 2.6 | 3.9 | 3.9 | 3.9 | 3.9 | 3.9 | 3.9 |
| SEPA | 21 | | | 21.0 | 21.0 | 21.0 | 21.0 | 21.0 | 21.0 | 21.0 | 21.0 | 21.0 | 21.0 | 21.0 | 21.0 | 21.0 | 21.0 | 21.0 |
| Nextera Wind REC's(Out of State) | 150 | | | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - |
| Salem Energy Systems LLC REC's | 60 | | | 30.0 | - | - | - | - | - | - | - | - | - | - | - | - | - | - |
| Other Renewable Resources/REC's needed | | | | - | - | - | - | - | - | - | 53.6 | 239.0 | 243.8 | 250.0 | 256.4 | 263.0 | 269.7 | 276.6 |
| Demand Side Management | | | | | | | | | | | | | | | | | | |
| | | | | # Customers | Demand Reduction | | Days in DSM | | | | | | | | | | | |
| DEMAND SIDE MANAGEMENT PROGRAMS: Activated during Peak Hours | | | | | | | | | | | | | | | | | | |
| Residential Water Heaters | 23,659 | | 0 | 3.6 | 3.6 | 3.6 | 3.6 | 3.6 | 3.6 | 3.6 | 3.6 | 3.6 | 3.6 | 3.6 | 3.6 | 3.6 | 3.6 | 3.6 |
| Coincident Peak Commercial/Industrial Consumers | 30 | | 42 hours | 8.0 | 8.0 | 8.0 | 8.0 | 8.0 | 8.0 | 8.0 | 8.0 | 8.0 | 8.0 | 8.0 | 8.0 | 8.0 | 8.0 | 8.0 |
| Residential Air Conditioners | 26,470 | | 0 | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - |
| | | | | | 11.6 | 11.6 | 11.6 | 11.6 | 11.6 | 11.6 | 11.6 | 11.6 | 11.6 | 11.6 | 11.6 | 11.6 | 11.6 | 11.6 |
| Annual Peak Demands(6) | | | | | | | | | | | | | | | | | | |
| 2008 Peak-Jan 25th, 2008 HE 8:00am --555 MW | | | | | | | | | | | | | | | | | | |
| 2009 Peak-Jan 17th, 2009 HE 9:00am --607 MW | | | | | | | | | | | | | | | | | | |

1. Net Peak is EnergyUnited's peak net of load management measured at generation.
2. All purchases are 100% firm with reserves provided by the supplying entity.
3. The term of the initial purchase with Morgan Stanley is 7 years beginning in 2004. All current and future resources provided by Morgan Stanley are firm; the Morgan Stanley purchase is a network resource recognized by Duke Transmission.
Resources provided by Morgan to serve load in the Duke control area will come from resources in the Duke control area or through imports made with firm transmission at interties with Southern, AEP, and Yadkin. These firm transmission purchases have been designated in the application with the transmission provider.
4. The initial term of the purchase with Southern Power/Southern Company is September 1, 2006 thru December 31, 2025. All current and future resources provided by Southern are firm; the Southern purchase is a network resource recognized by Duke Transmission. Resources provided by Southern will come from resources in the Duke control area or through imports made with firm transmission at the Duke/Southern intertie. These firm transmission purchases have been designated in the application with the transmission provider or will be designated prior to the start of the start of applicable resource. Under this contract, Southern is obligated to provide all necessary reserve capacity up to 15% of EnergyUnited Peak Load
5. Energy values are measured at generation.
6. Demand Side Management allows us to reduce 12MW during peak periods at our option using load management devices and backup generation.

Table 1.4-EnergyUnited Summer and Winter Peak Load Duration Curves


Summer 2008

| Year | Month | Day | Hour | EMC Total |
|------|-------|-----|------|-----------|
| 2008 | 6 | 9 | 1 | 301,646 |
| 2008 | 6 | 9 | 2 | 269,674 |
| 2008 | 6 | 9 | 3 | 247,694 |
| 2008 | 6 | 9 | 4 | 232,148 |
| 2008 | 6 | 9 | 5 | 227,026 |
| 2008 | 6 | 9 | 6 | 243,101 |
| 2008 | 6 | 9 | 7 | 270,852 |
| 2008 | 6 | 9 | 8 | 295,711 |
| 2008 | 6 | 9 | 9 | 320,060 |
| 2008 | 6 | 9 | 10 | 362,885 |
| 2008 | 6 | 9 | 11 | 413,831 |
| 2008 | 6 | 9 | 12 | 459,108 |
| 2008 | 6 | 9 | 13 | 497,547 |
| 2008 | 6 | 9 | 14 | 526,515 |
| 2008 | 6 | 9 | 15 | 545,897 |
| 2008 | 6 | 9 | 16 | 555,085 |
| 2008 | 6 | 9 | 17 | 554,888 |
| 2008 | 6 | 9 | 18 | 558,066 |
| 2008 | 6 | 9 | 19 | 546,251 |
| 2008 | 6 | 9 | 20 | 524,291 |
| 2008 | 6 | 9 | 21 | 518,357 |
| 2008 | 6 | 9 | 22 | 495,004 |
| 2008 | 6 | 9 | 23 | 436,994 |
| 2008 | 6 | 9 | 24 | 372,200 |

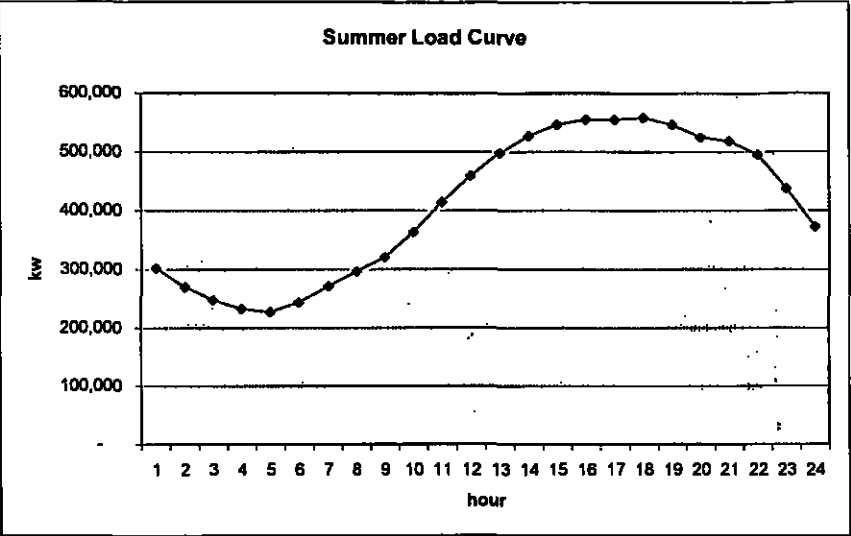


Load Duration Information

| Hour | EMC Total |
|------|-----------|
| 18 | 558,066 |
| 16 | 555,085 |
| 17 | 554,888 |
| 19 | 546,251 |
| 15 | 545,897 |
| 14 | 526,515 |
| 20 | 524,291 |
| 21 | 518,357 |
| 13 | 497,547 |
| 22 | 495,004 |
| 12 | 459,108 |
| 23 | 436,994 |
| 11 | 413,831 |
| 24 | 372,200 |
| 10 | 362,885 |
| 9 | 320,060 |
| 1 | 301,646 |
| 8 | 295,711 |
| 7 | 270,852 |
| 2 | 269,674 |
| 3 | 247,694 |
| 6 | 243,101 |
| 4 | 232,148 |
| 5 | 227,026 |

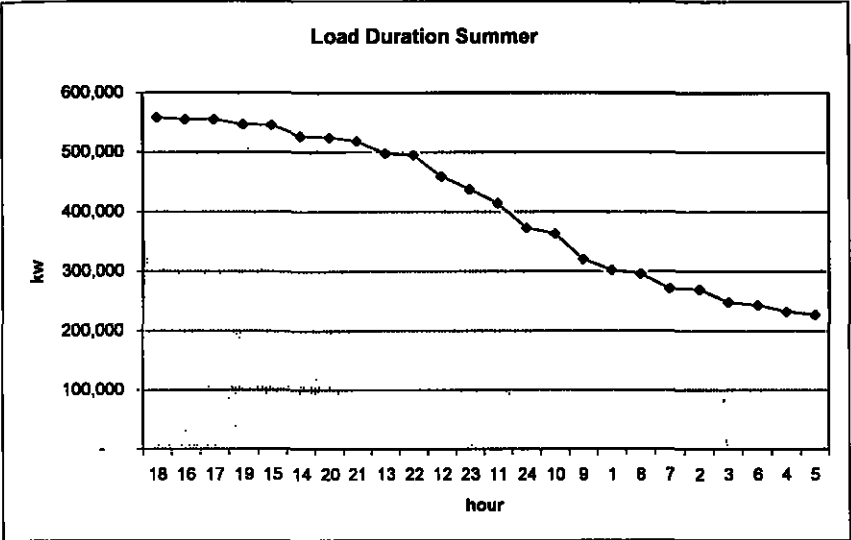


Winter 2008/2009

| Year | Month | Day | Hour | EMC Total |
|------|-------|-----|------|-----------|
| 2009 | 1 | 17 | 1 | 481238 |
| 2009 | 1 | 17 | 2 | 491639 |
| 2009 | 1 | 17 | 3 | 505465 |
| 2009 | 1 | 17 | 4 | 522535 |
| 2009 | 1 | 17 | 5 | 541194 |
| 2009 | 1 | 17 | 6 | 560964 |
| 2009 | 1 | 17 | 7 | 586195 |
| 2009 | 1 | 17 | 8 | 602572 |
| 2009 | 1 | 17 | 9 | 606619 |
| 2009 | 1 | 17 | 10 | 556571 |
| 2009 | 1 | 17 | 11 | 506959 |
| 2009 | 1 | 17 | 12 | 464769 |
| 2009 | 1 | 17 | 13 | 424373 |
| 2009 | 1 | 17 | 14 | 389845 |
| 2009 | 1 | 17 | 15 | 372273 |
| 2009 | 1 | 17 | 16 | 373633 |
| 2009 | 1 | 17 | 17 | 395620 |
| 2009 | 1 | 17 | 18 | 423877 |
| 2009 | 1 | 17 | 19 | 443976 |
| 2009 | 1 | 17 | 20 | 435099 |
| 2009 | 1 | 17 | 21 | 424407 |
| 2009 | 1 | 17 | 22 | 412001 |
| 2009 | 1 | 17 | 23 | 393849 |
| 2009 | 1 | 17 | 24 | 371804 |

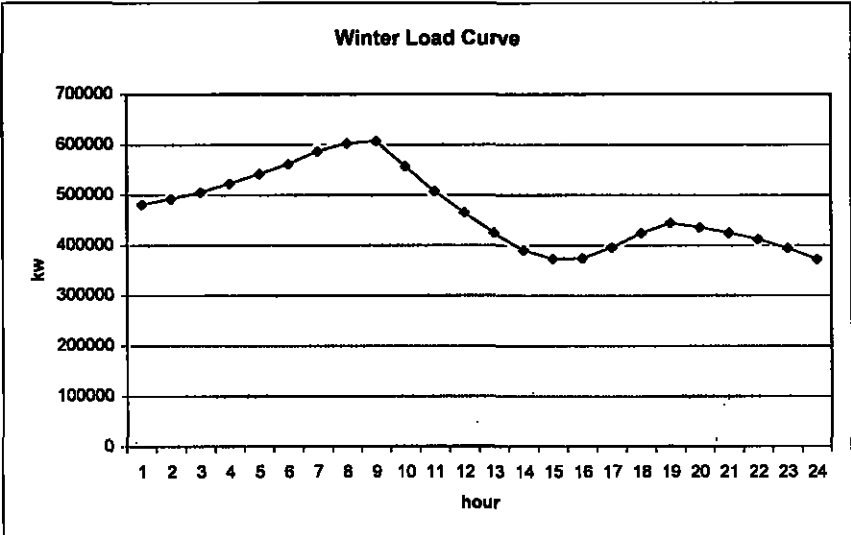

Load Duration Information

| Hour | EMC Total |
|------|-----------|
| 9 | 606619 |
| 8 | 602572 |
| 7 | 586195 |
| 6 | 560964 |
| 10 | 556571 |
| 5 | 541194 |
| 4 | 522535 |
| 11 | 506959 |
| 3 | 505465 |
| 2 | 491639 |
| 1 | 481238 |
| 12 | 464769 |
| 19 | 443976 |
| 20 | 435099 |
| 21 | 424407 |
| 13 | 424373 |
| 18 | 423877 |
| 22 | 412001 |
| 17 | 395620 |
| 23 | 393849 |
| 14 | 389845 |
| 16 | 373633 |
| 15 | 372273 |
| 24 | 371804 |

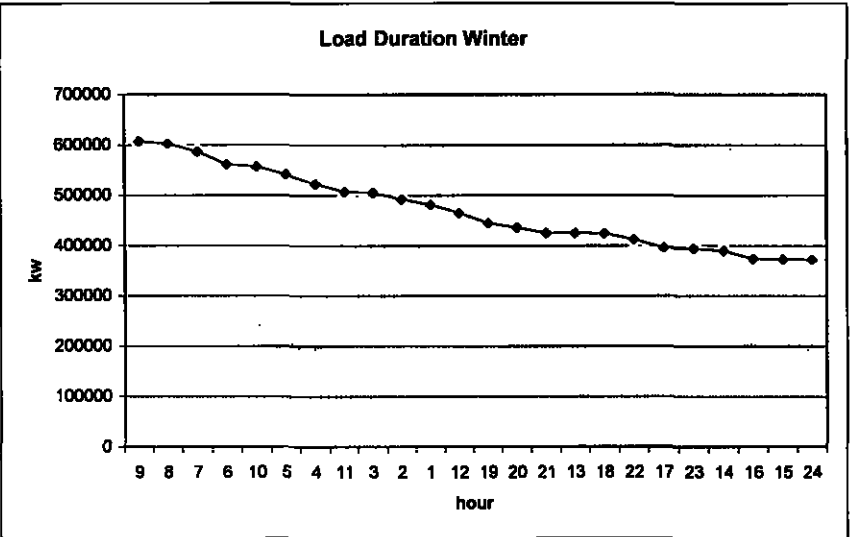

2. Generating Facilities:

EnergyUnited does not own any generating units and does not have any plans to purchase or construct electric generating facilities

The only non-utility generator currently in service on the EnergyUnited system is a 10KW solar photovoltaic unit owned by Aquesta Bank in Cornelius, North Carolina. This unit is designated to be a summer peaking unit.

3. Reserve Margins:

See Table 1.2 and Table 1.3 for more information. Under EnergyUnited's contract with Southern Power Company, Southern Power is obligated to provide EnergyUnited for up to 15% of peak load to account for EnergyUnited's reserve margin.

4. Wholesale Contracts for the Purchase and Sale of Power:

a. Wholesale Purchased Power Contracts:

| <u>Resource</u> | <u>LOCATION</u> | <u>FUEL SOURCE</u> | <u>CAPACITY DESIGNATION</u> | <u>MW</u> | <u>Expiration Date</u> |
|-----------------------------|-----------------|--------------------|-----------------------------|-----------|------------------------|
| Catawba Nuclear Station | South Carolina | Nuclear | Base | 79.0 | N/A |
| AEP Purchase | PJM | Coal | Base | 26.0 | 2010 |
| CP&L SOR A | North Carolina | Mix | Base | 29.0 | 2010 |
| Southern Power | Various | Mix | Base/Inter/Peaking | 132.0 | N/A |
| SCE&G Intermediate Resource | South Carolina | Gas | Intermediate/Peaking | 32.0 | 2012 |
| AEP Baseload Resource | PJM | Mix | Base | 19.0 | 2012 |
| Dominion PPA | PJM | Mix | Intermediate/Peaking | 19.0 | 2014 |
| SEPA | Southeast | Hydro | Intermediate/Peaking | 16.0 | N/A |
| Morgan Stanley | Various | Mix | Base/Intermediate | 249.0 | 2010 |
| Iredell Transmission | Iredell County | Methane | Base | 3.0 | 2018 |

5. Transmission Facilities

EnergyUnited has no transmission facilities of 161 kV or higher.

6. Demand-Side Management

- Existing Programs: See Table 1.2 and 1.3 for details of demand-side management programs currently offered.
- Proposed Programs: EnergyUnited currently has no new proposed programs.
- Evaluated but Rejected Programs: EnergyUnited currently has no evaluated but rejected programs.
- Consumer Education Programs: EnergyUnited produces a monthly communication with its membership that offers ongoing education regarding renewables and conservation. EnergyUnited has added a renewable section to the website to keep

members informed of new programs and opportunities to reduce consumption and increase awareness of renewables.

7. **Assessment of Alternative Supply-Side Energy Resource:** It is the opinion of EnergyUnited that there are sufficient resources and potential resources to meet the requirements of the REPS.
8. **Evaluation of Resource Options:** EnergyUnited is continuing to evaluate its resources options in an effort to create the most reliable and affordable portfolio for its membership.

Section II: EnergyUnited's Short Term Action Plan

EnergyUnited hopes to commission its 1 MW solar farm by December 2009, which will cover one third of EnergyUnited's 2018 solar requirements. In the coming months pending NCUC approval, EnergyUnited hopes to deploy its current energy efficient programs to its membership as well as continue to create Consumer Education Programs.

Section III: EnergyUnited's REPS Compliance Plan

See Table 1.2 and 1.3 regarding REPS resources. Beginning 2010, EnergyUnited plans to fulfill the solar wedge requirement through its construction of the 1 MW solar array. EnergyUnited will utilize its landfill gas generation in Iredell County along with REC's from SEPA, Salem Energy, and Nextera Energy to begin to meet the requirements of the REPS. EnergyUnited anticipates the roll out of Energy Efficiency programs by 2010 along with several other potential renewable resources that can be utilized to meet the compliance levels each year.

CERTIFICATION

I hereby certify the data included in this report was taken from the books and records of the reporting company and is true and correct to the best of my knowledge.

SIGNATURE OF CERTIFYING PERSON:




NAME OF CERTIFYING PERSON (TYPE OR PRINT): H. Wayne Wilkins

TITLE OF CERTIFYING PERSON: Chief Executive Officer, EnergyUnited EMC

NOTARIZATION

Sworn to and subscribed to me this 31st day of August



Notary Public

My Commission Expires: June 3, 2014