


- NOTES:
1. SITE HAS A MINIMUM SETBACK OF 75' FROM ALL PROPERTY BOUNDARIES AND 300' FROM ALL RESIDENTIAL PROPERTY BOUNDARIES.
 2. A CONTINUOUS EVERGREEN VEGETATIVE BUFFER SHALL BE INSTALLED AND MAINTAINED AT ALL TIMES AROUND THE PERIMETER OF THE FENCE AND WITHIN THE SETBACK AREAS WHEREVER NATURAL FROEST VEGETATION DOES NOT EXIST. THE EVERGREEN VEGETATIVE BUFFER SHALL BE COMPOSED OF EVERGREEN TREES OR SHRUBS WHICH AT PLANTING SHALL BE A MINIMUM OF 4' IN HEIGHT. THE EVERGREEN TREES OR SHRUBS SHALL BE SPACED NO MORE THAN 10' APART ON CENTER. AT MATURITY, REQUIRED VEGETATIVE SCREENING SHALL BE NO LESS THAN 15' IN HEIGHT.
 3. INVERTERS WILL BE NO LESS THAN 100' FROM ANY DWELLING UNIT.

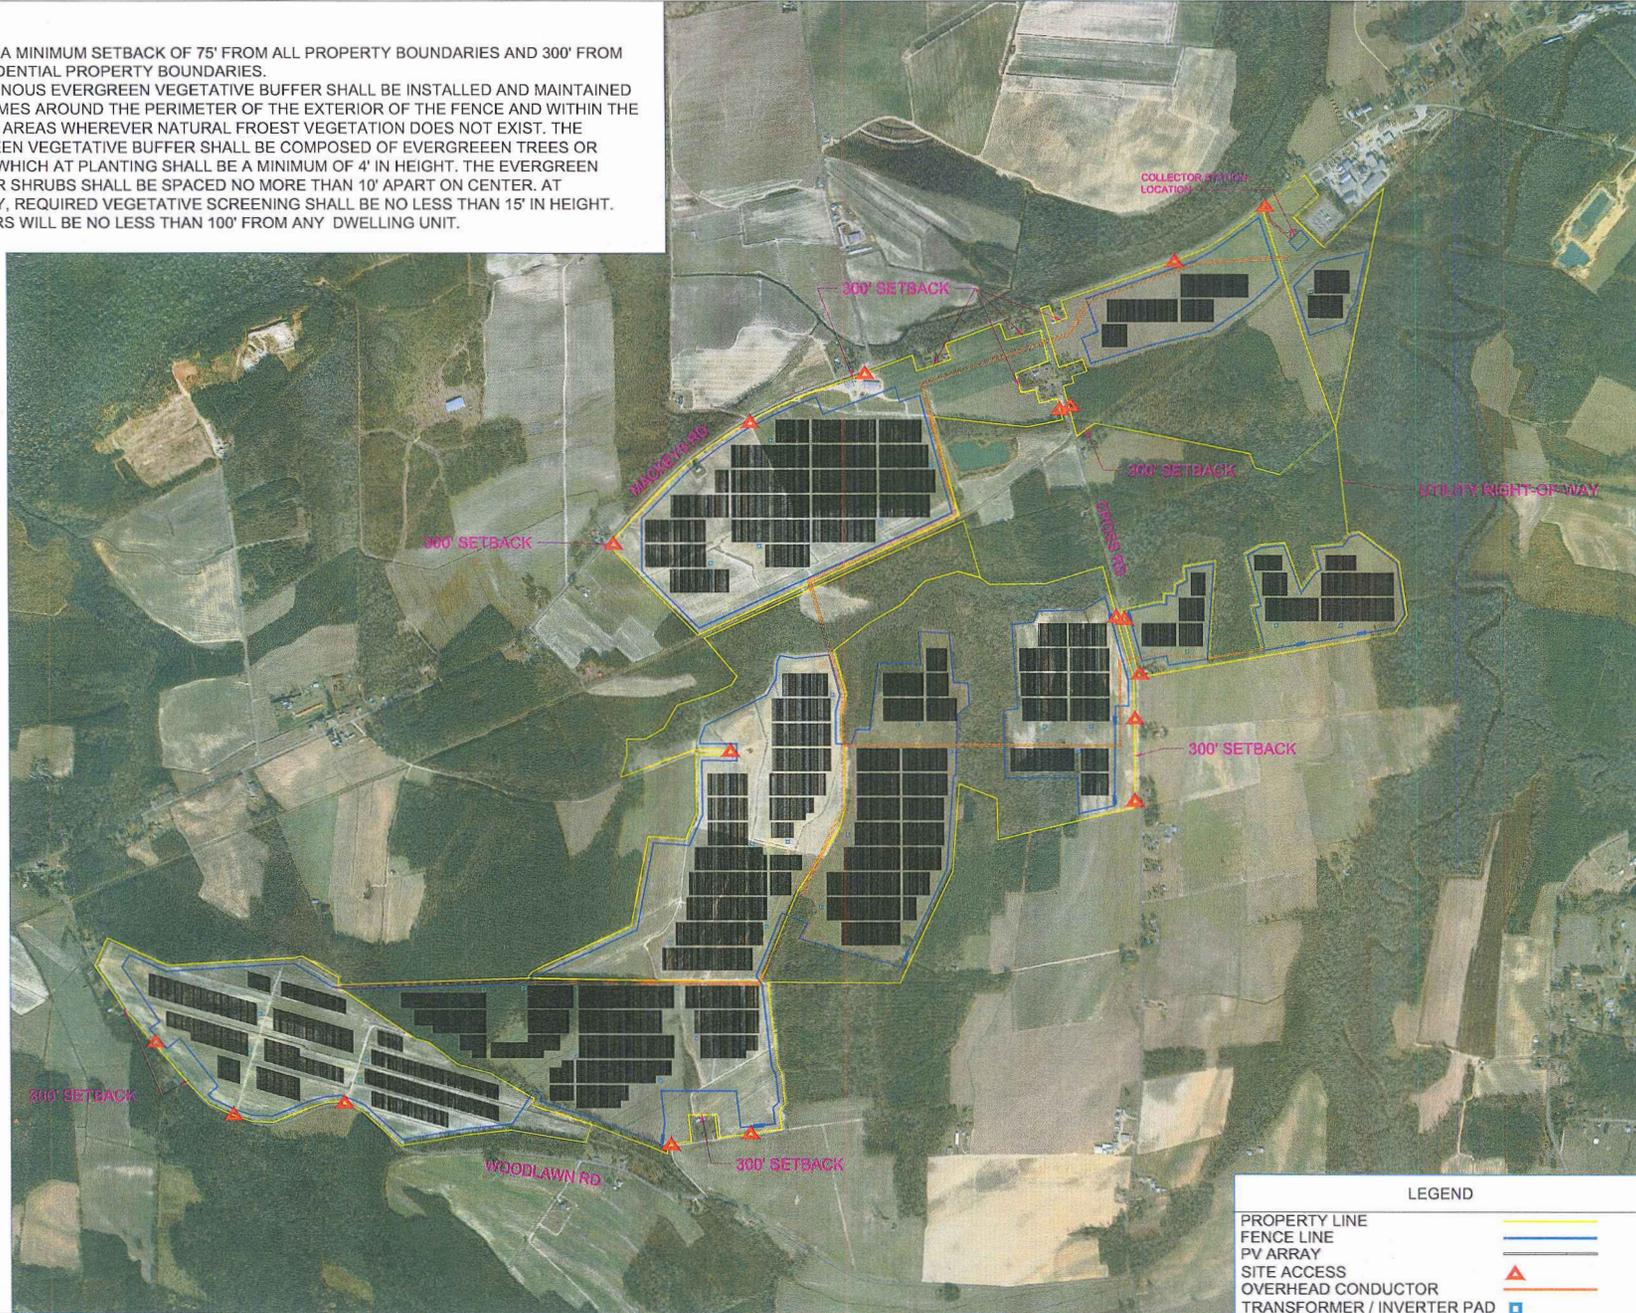

LEGEND

| | |
|----------------------------|--|
| PROPERTY LINE | |
| FENCE LINE | |
| PV ARRAY | |
| SITE ACCESS | |
| OVERHEAD CONDUCTOR | |
| TRANSFORMER / INVERTER PAD | |

| | |
|--|------------------|
| | |
| 192 Raceway Dr. Mooresville, NC 28117 (T) 704-662-0375 (F) 704-662-0352 | |
| PROJECT NAME ALBEMARLE BEACH SOLAR IN Washington County NC | DATE 04-12-18 |
| SHEET NO. LN | DATE 07-19-18 |
| DRAWING TITLE PRELIMINARY SITE LAYOUT | DRAWN BY CJM |
| DRAWING NO. SL.1.1 | CHECKED BY |