



NOTES:

1. SITE HAS A MINIMUM SETBACK OF 75' FROM ALL PROPERTY BOUNDARIES AND 300' FROM ALL RESIDENTIAL PROPERTY BOUNDARIES.
2. A CONTINUOUS EVERGREEN VEGETATIVE BUFFER SHALL BE INSTALLED AND MAINTAINED AT ALL TIMES AROUND THE PERIMETER OF THE EXTERIOR OF THE FENCE AND WITHIN THE SETBACK AREAS WHEREVER NATURAL FROEST VEGETATION DOES NOT EXIST. THE EVERGREEN VEGETATIVE BUFFER SHALL BE COMPOSED OF EVERGREEN TREES OR SHRUBS WHICH AT PLANTING SHALL BE A MINIMUM OF 4' IN HEIGHT. THE EVERGREEN TREES OR SHRUBS SHALL BE SPACED NO MORE THAN 10' APART ON CENTER. AT MATURITY, REQUIRED VEGETATIVE SCREENING SHALL BE NO LESS THAN 15' IN HEIGHT.
3. INVERTERS WILL BE NO LESS THAN 100' FROM ANY DWELLING UNIT.

EMP-103 Sub 0

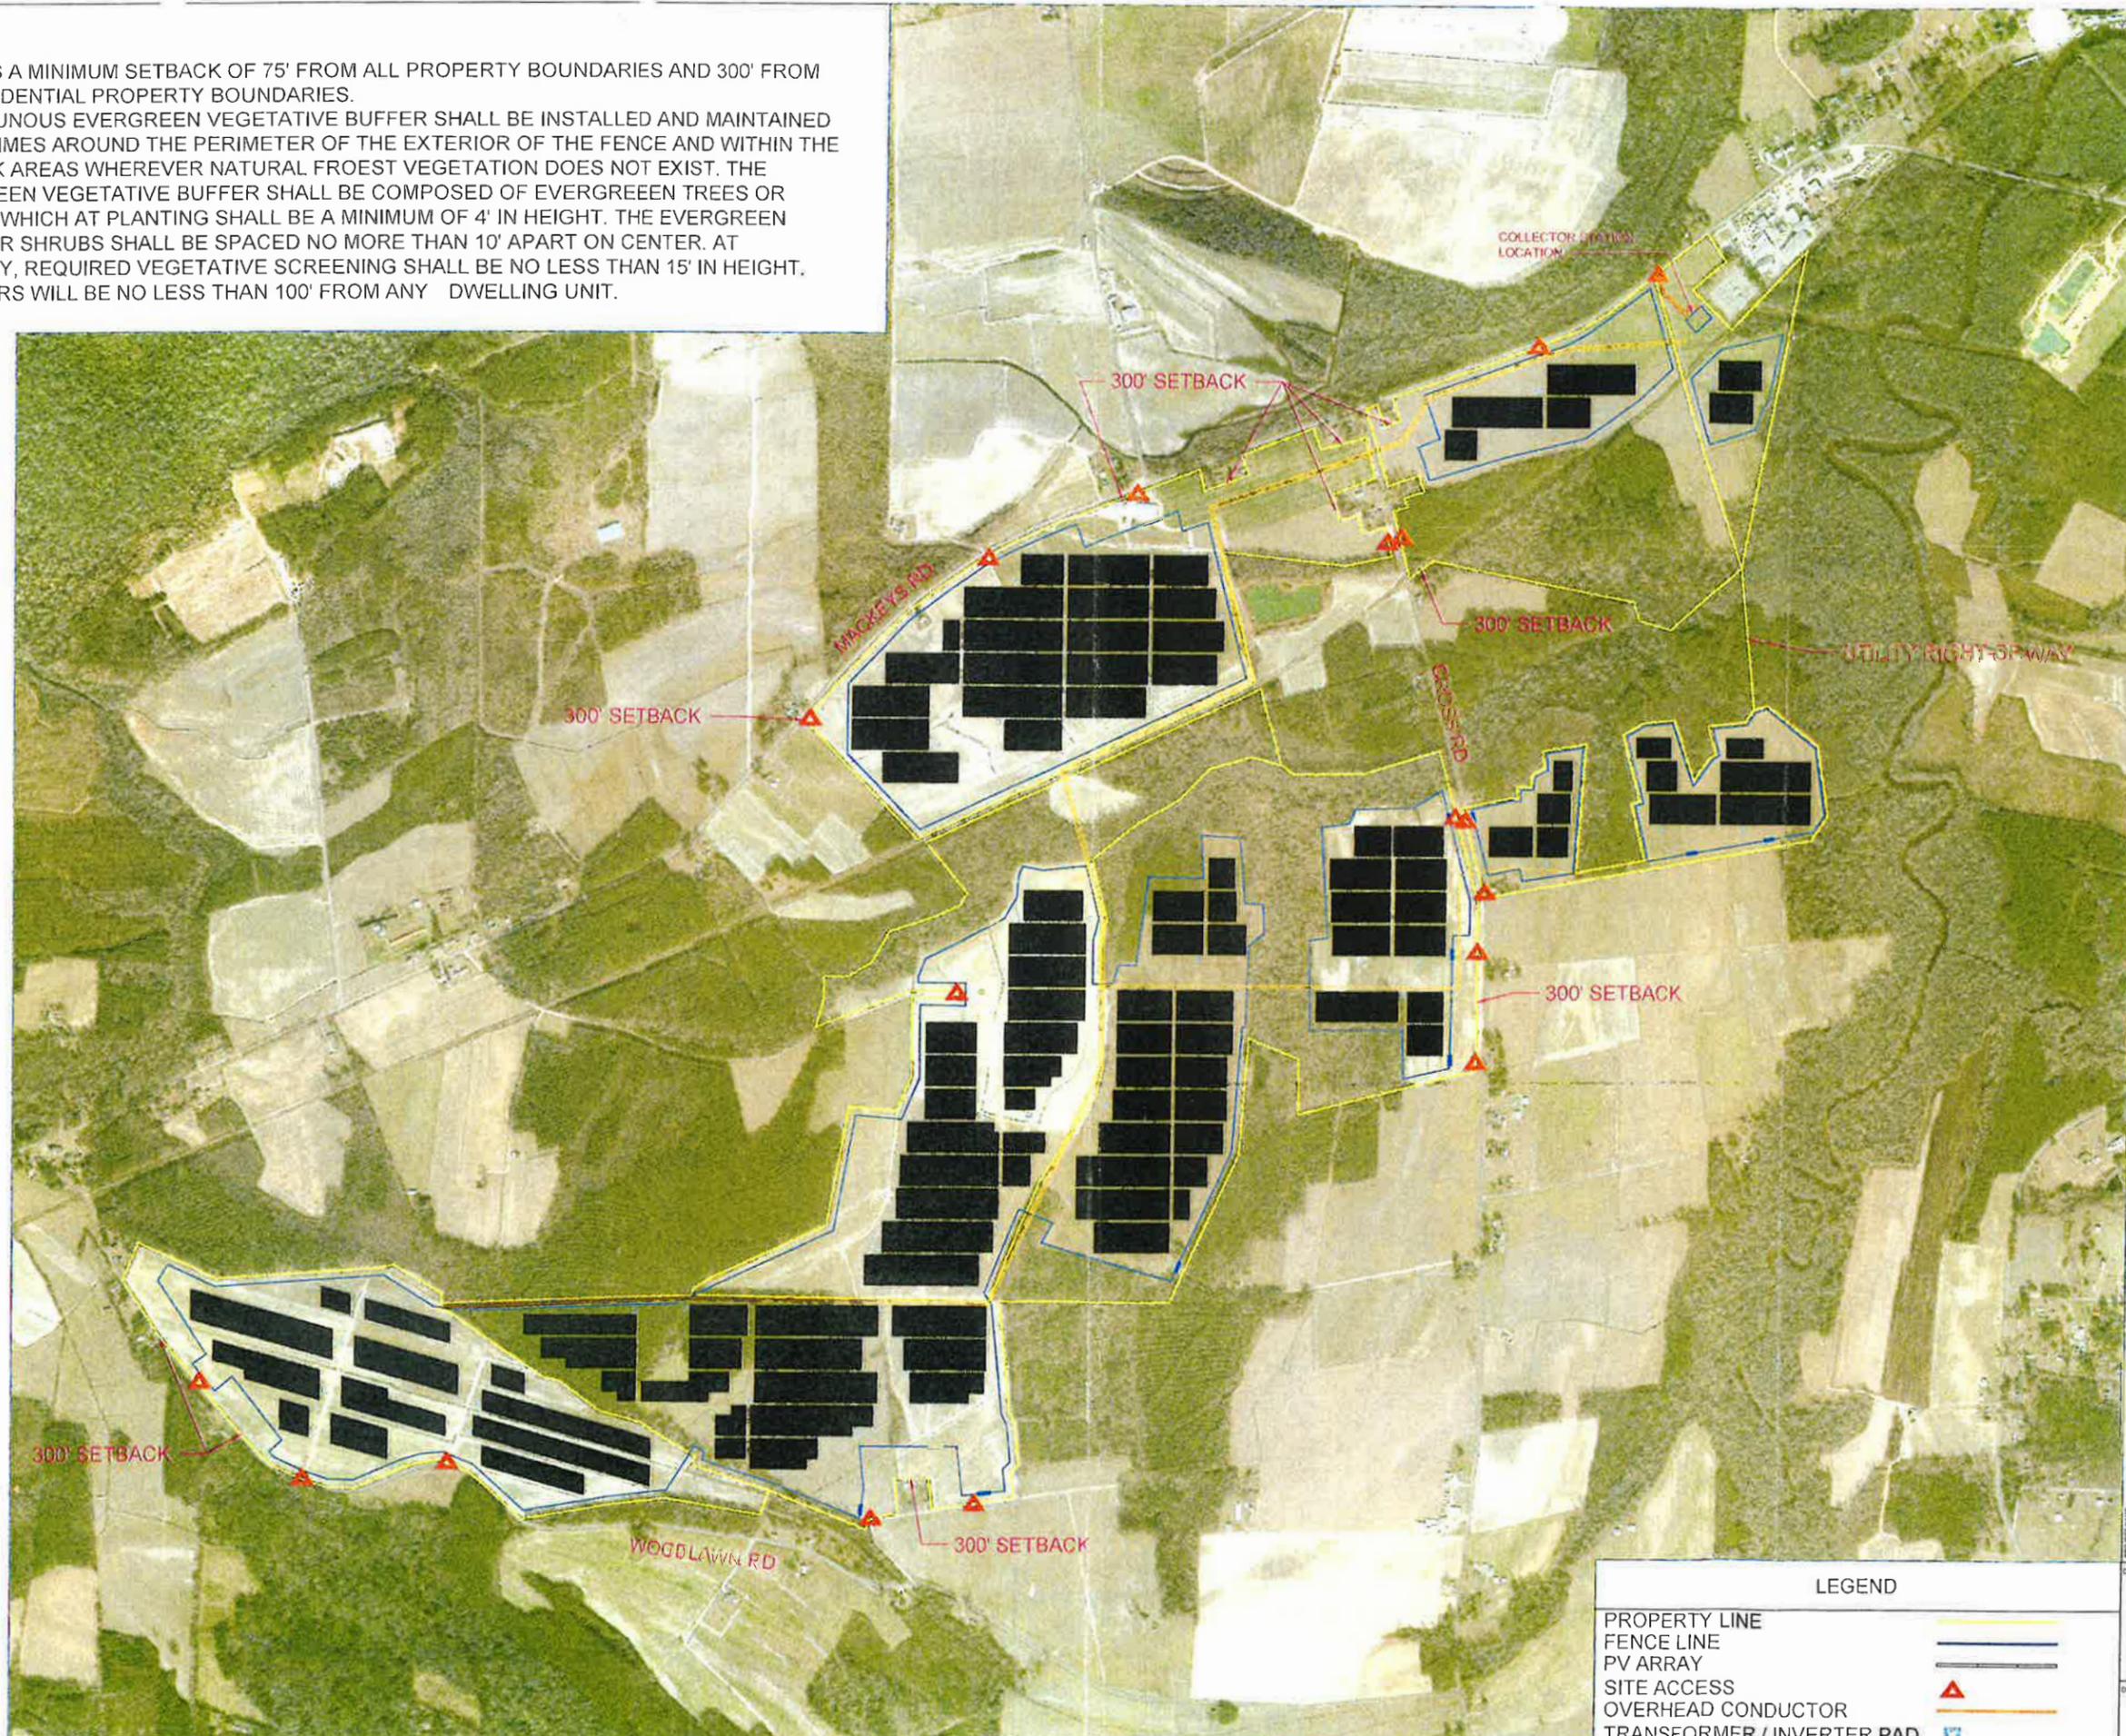

SUNENERGY1
 192 Raceway Dr.
 Mooresville, NC 28117
 (T) 704-862-0375
 (F) 704-862-0352

NO.	DATE	DESCRIPTION	DESIGNER	DATE
1		PRELIMINARY LAYOUT		

ALBEMARLE BEACH SOLAR IN Washington County NC	
DATE DRAWING: 04-12-18	SCALE: AS SHOWN
DATE REVISION: 07-19-18	REVISION: 1

LEGEND	
PROPERTY LINE	
FENCE LINE	
PV ARRAY	
SITE ACCESS	
OVERHEAD CONDUCTOR	
TRANSFORMER / INVERTER PAD	

DRAWING TITLE	PRELIMINARY SITE LAYOUT
DRAWING NO.	SL1.1